

ТЕХНИЧЕСКА СПЕЦИФИКАЦИЯ

Доставка на вентилатор DD12/9 модел M91C за кондиционер КТА-10, производство на NICOTRA GEBHARDT S.P.A

№	ИД по BAAN	Наименование	Технически характеристики	Марка/мерна единица	Количество
1	114498	Вентилатор	DD 12/9, модел M91C, V=5000m ³ /h, P=750Pa	бр.	30

Документи придружаващи доставката:

1. Сертификат/декларация за съответствие издадена от производителя.
2. Сертификат/декларация за произход.
3. Гаранционна карта/гаранции.
4. Инструкция за монтаж.




Документи да са преведени на български език.

Съгласувал:

Ръководител сектор "Р - ВКОС";

09.08.2025 г.

заличено на основание
ЗЗЛД

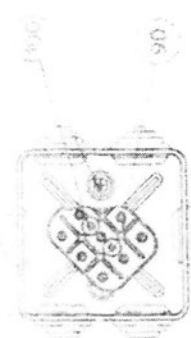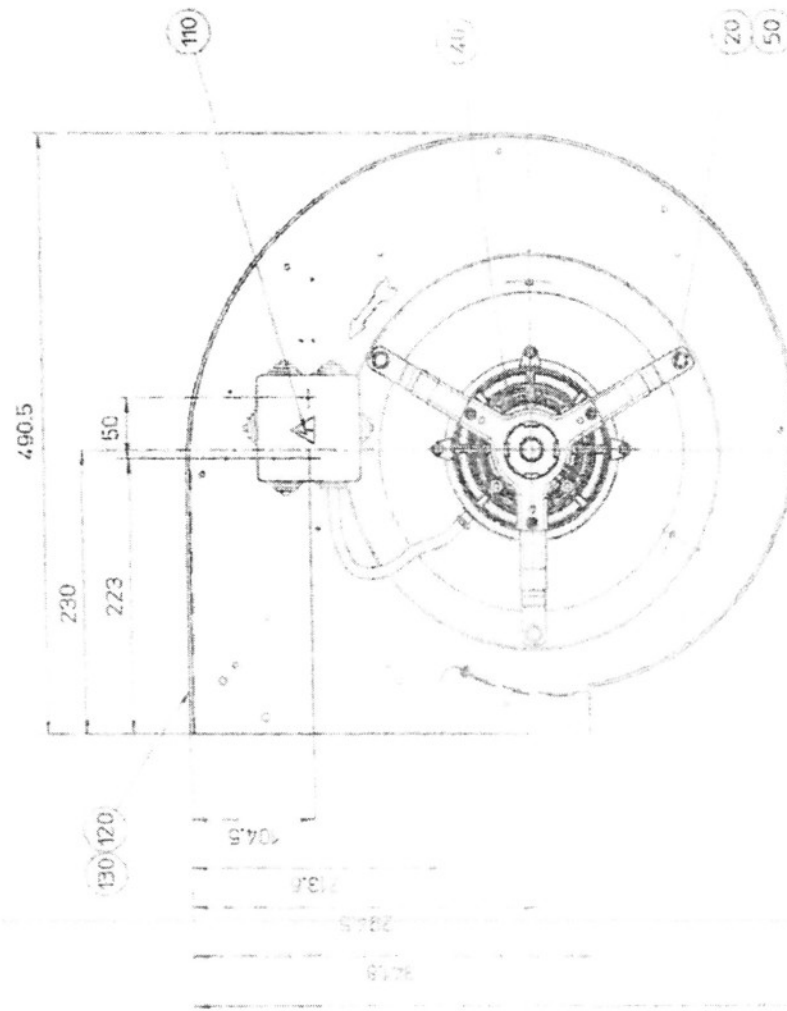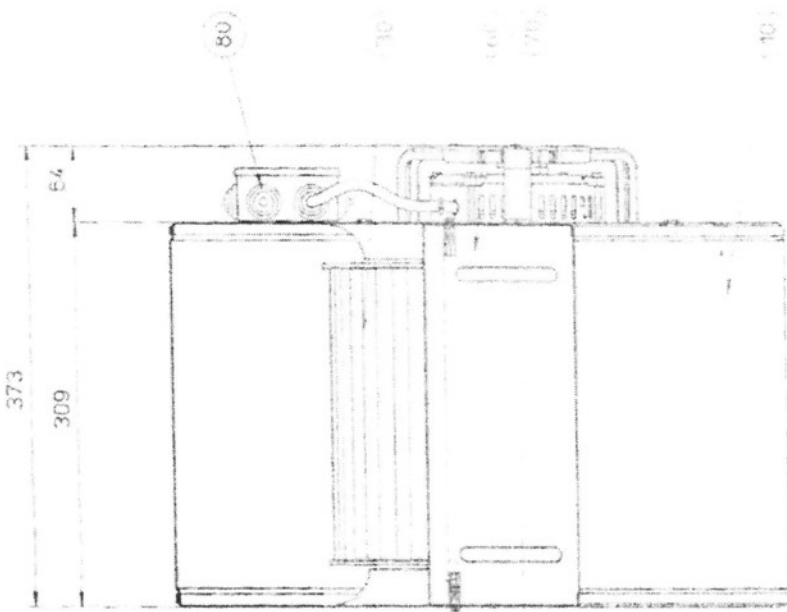

NICOTRA		CREATED BY	DESIGNED BY	REVISION
Nicotra Gebhardt S.p.A. Stabilimento di Zingonia - BG		RMAGON	UN ISO 22768/4	
DESCRIPTION		DATE	SCALE	REVISION
DD 12/9 M9C 3F 4P IV +SCT		03/05/2013	1/4	REVISION
CODE / REVISION		6N06C3 / 01		
APP. DES.		PAGE	NUM.	APP. DES.
6N06C300				6N06C300

Disegnato da: [signature]
 Verificato da: [signature]
 Approvato da: [signature]

NICOTRA Gebhardt

Zingonia

10000 m³/h test chamber

Fan test laboratory

AMCA 210/99 Fig. 12

Air Density (γ): 1.20 kg/m³

Installation type "B": free inlet, ducted outlet

dB(A) free field noise measurements at 1 m


Приложение 2

Type: DD 12/9
Motor: 14191C
Test n.: S4379.000
Date: 28/03/2013

Watt: 1500
Volt: 400 / 3~
Hz: 50
Poles: 4

Amp Max: 5.7
Prot.: IP 20
T.H.: YES-OUT
Ins. Cl.: F

ErP 2015

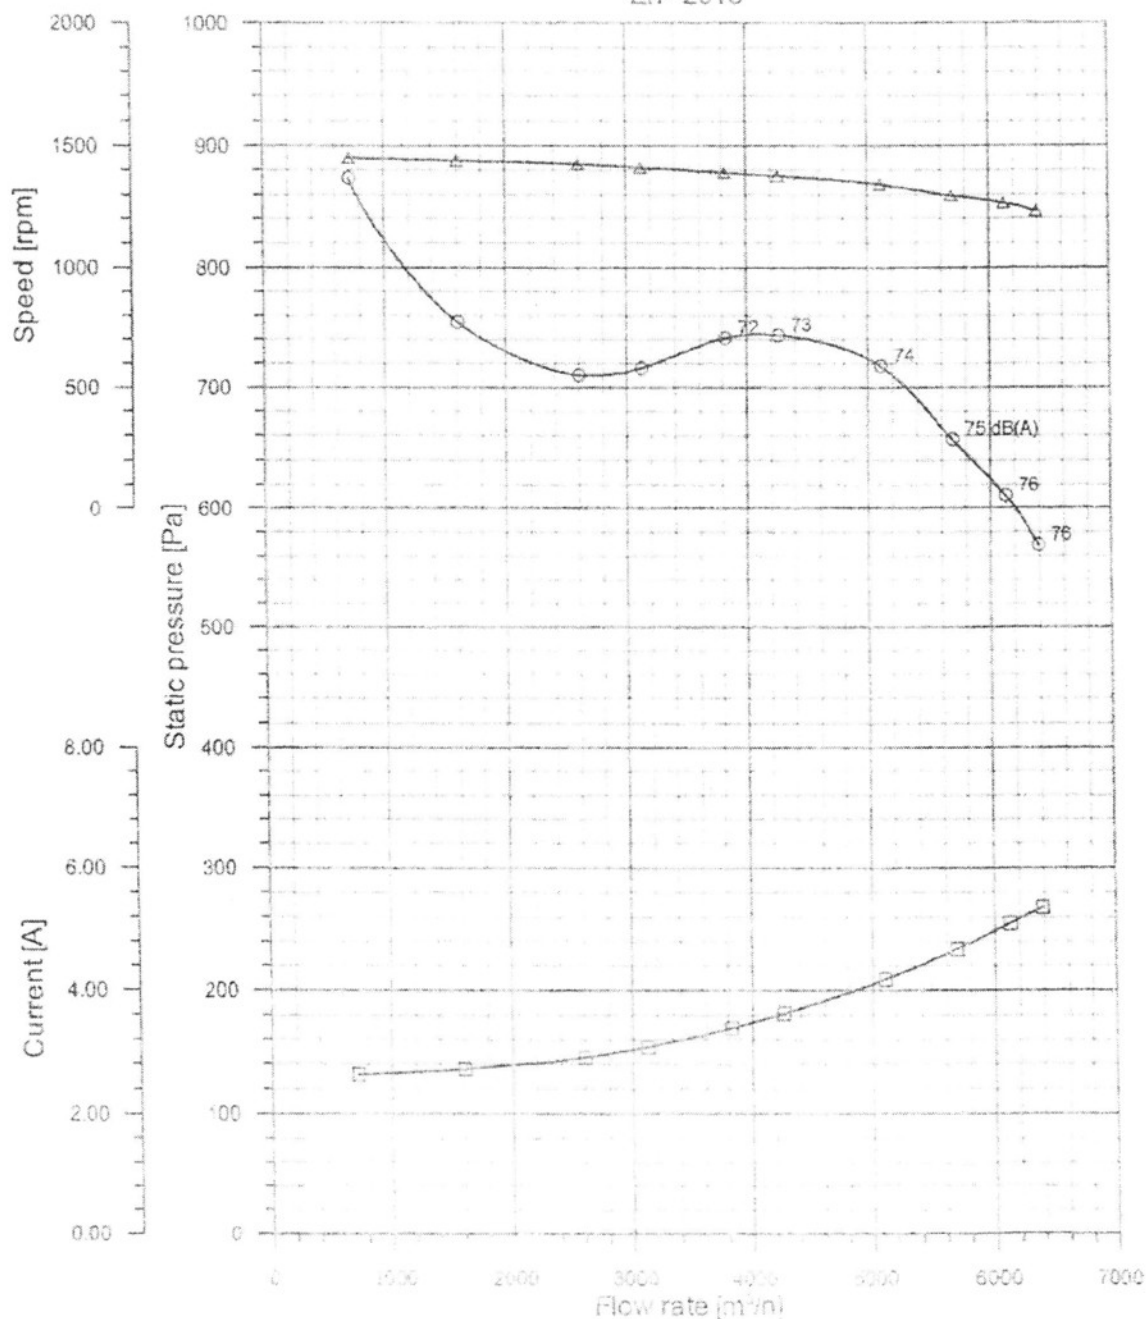

This test data obtained in a laboratory registered by AMCA for AMCA 210/99 air performance testing. Data is not certified by AMCA.